

EXHIBIT SCWA-3

Cumulative inflow to Lake Phillsbury (Acre Feet) as of							Water Supply Conditions Prevailing on 6/1 Apply Through 12/31
	1/1	2/1	3/1	4/1	5/1	6/1	
NORMAL	≥8,000	≥39,200	≥65,700	≥114,500	≥145,600	≥160,000	
DRY	<8,000	<39,200	<65,700	<114,500	<145,600	<160,000	
CRITICAL	<4,000	<20,000	<45,000	<50,000	<70,000	<75,000	


LEGEND

All flows are minimums, expressed in cubic feet per second.

* Unless Lake Sonoma Elevation is below 292.0, or if prohibited by the United States Government.

AF Acre Feet

- USGS Stream Gage

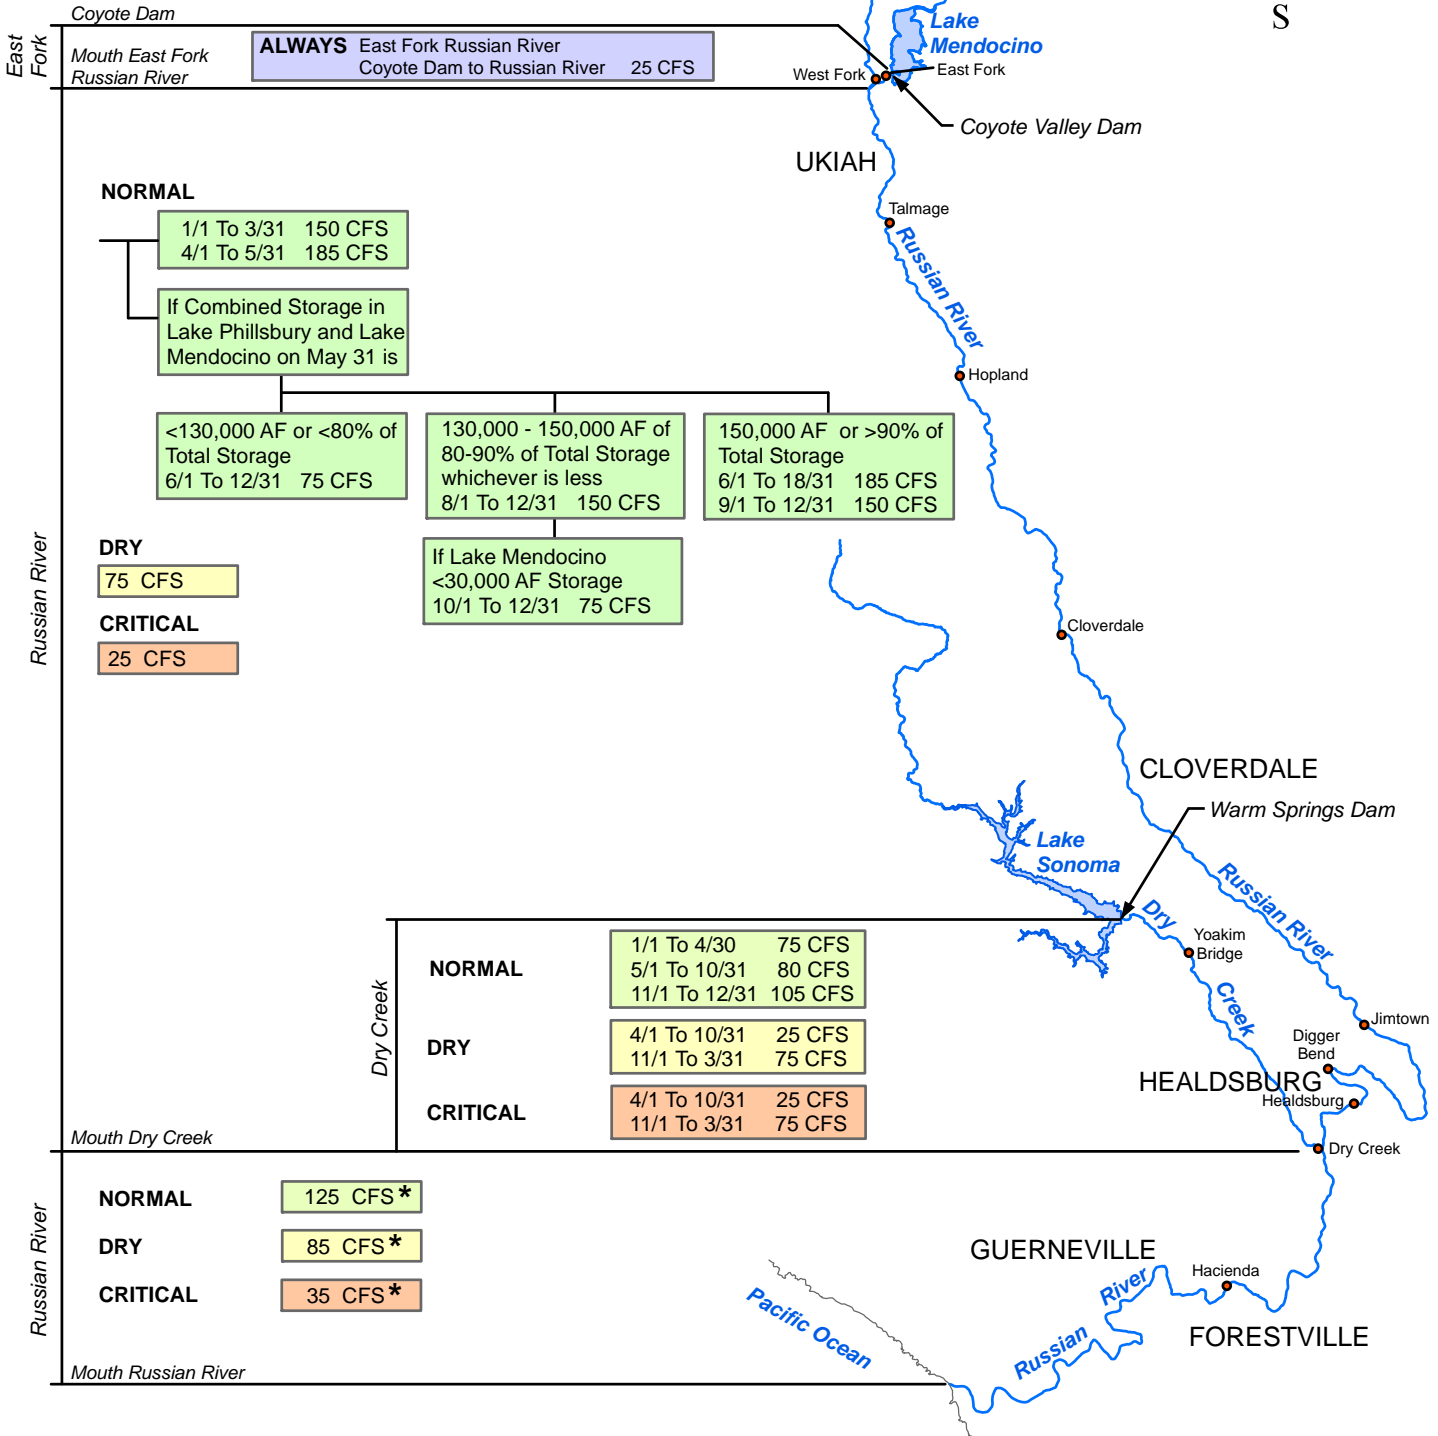

Russian River Basin Streamflow Requirements

Per State Water Resources Control Board Decision 1610, April 1986